
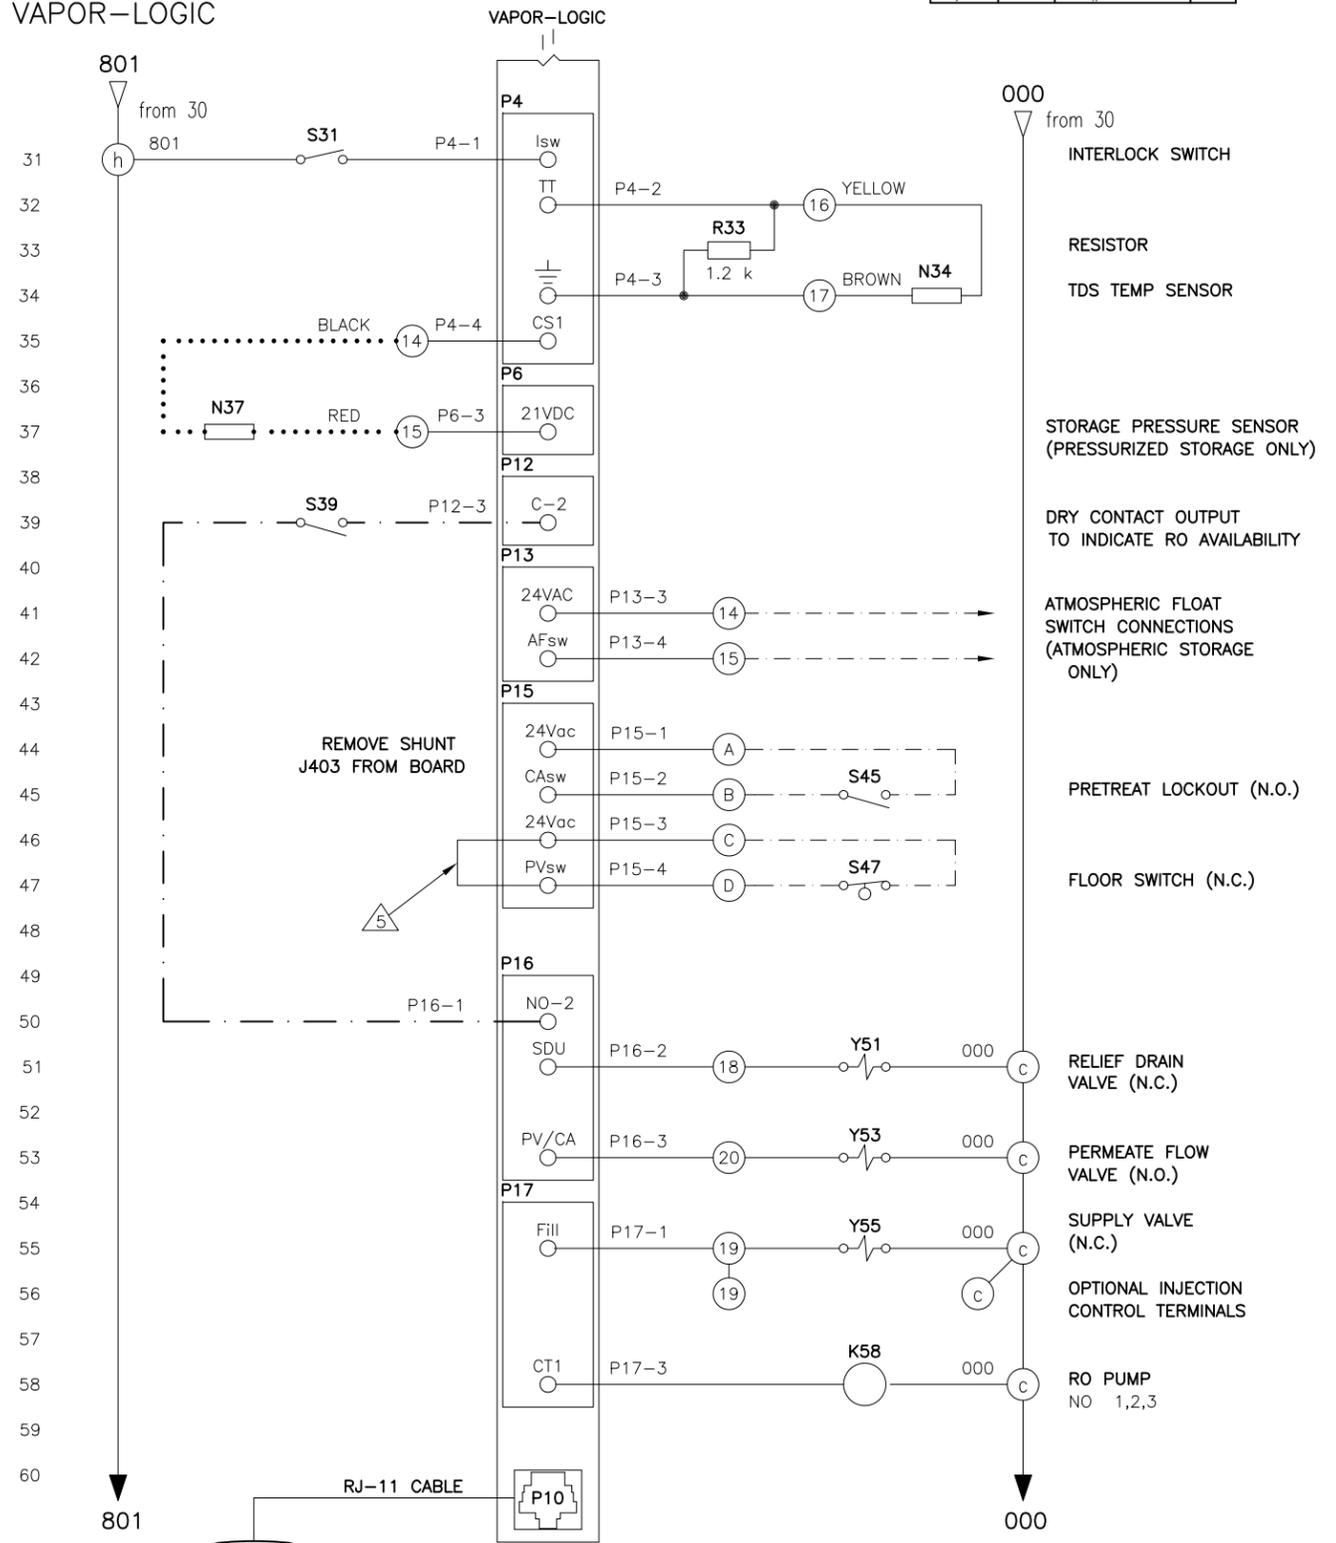


HYDROTRUE® WATER TREATMENT STATION

FACTORY WIRING DIAGRAM WITH VAPOR-LOGIC (THREE PHASE)

DATE	REV	RECORD	DR
10/25	A	E.C.# 7447	JK

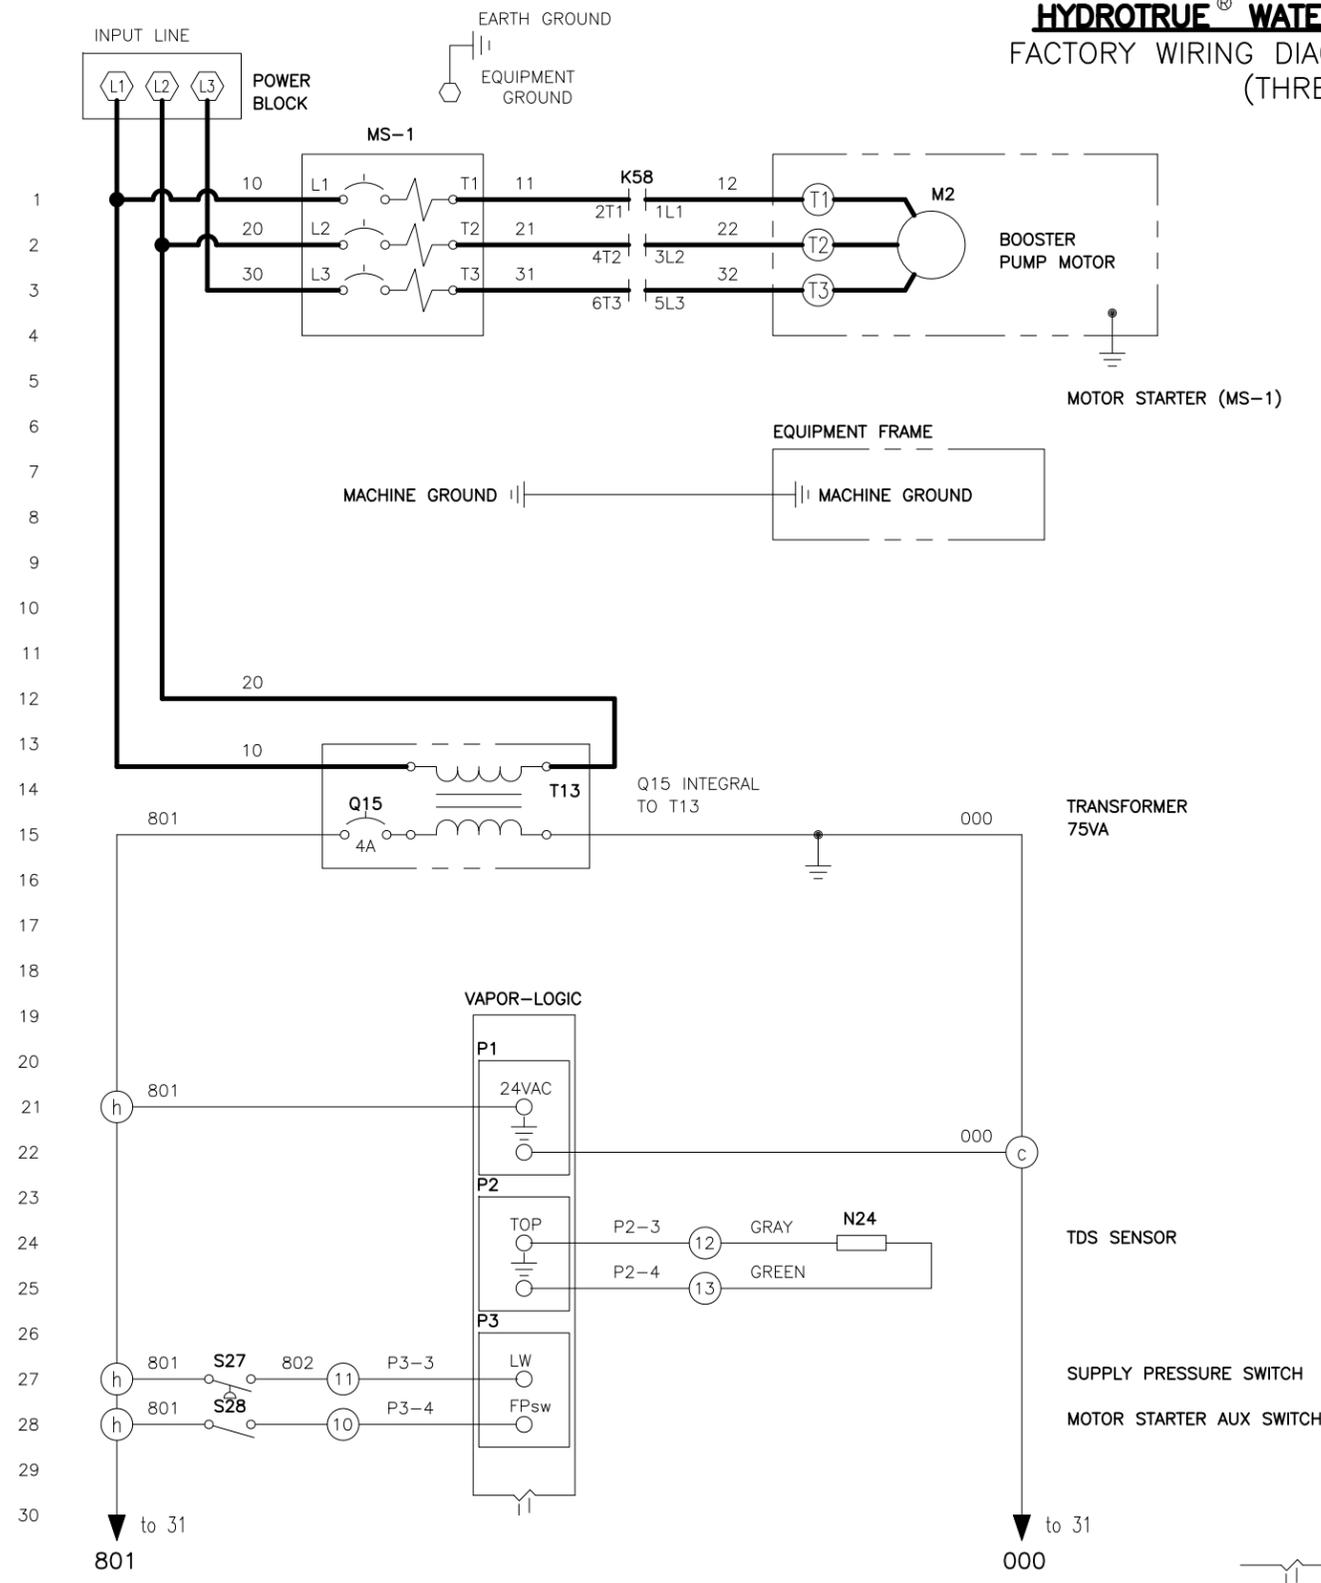

- NOTES:**
1. WIRING & BRANCH CIRCUIT PROTECTION PROVIDED BY INSTALLER AS PER NATIONAL ELECTRICAL CODE.
 2. FOR SUPPLY CONNECTIONS SIZE WIRE USING 75° C WIRE TABLE PER NATIONAL ELECTRICAL CODE,
 3. USE COPPER CONNECTORS RATED FOR 105° C.
 4. REFER TO RO ELECTRICAL DATA SHEET.
 5. REMOVE JUMPER IF USING OPTIONAL FLOOR SWITCH.

LEGEND

K	RELAY/CONTACTOR	Y	SOLENOID
T	TRANSFORMER	N	SENSOR
Q	CIRCUIT BREAKER	J	JUMPER
S	SWITCH	E	WATER PROBE
H	HEATER	M	MOTOR/FAN
F	FUSE	MS	MOTOR STARTER
VFD	VARIABLE FREQUENCY DRIVE		

- POWER WIRING**
CONTROL CIRCUIT WIRING
- FIELD WIRING**
OPTIONAL FACTORY
OPTIONAL FIELD

	WATER TREATMENT STATION VAPOR-LOGIC THREE PHASE WIRING DIAGRAM	
	MATERIAL:	P/N
	SCALE:	WT-VL-2-3PH-
DRAWN BY: JK	HYDROTRUE	
DATE: 10/7/25		

BREAK TO EXTERNAL CONNECTIONS DIAGRAM