



# HYDROTRUE® RO-200 WATER TREATMENT STATION

## FACTORY WIRING DIAGRAM WITH VAPOR-LOGIC

DATE	REV	RECORD	DR
12/25	A	E.C.# 7447	JK

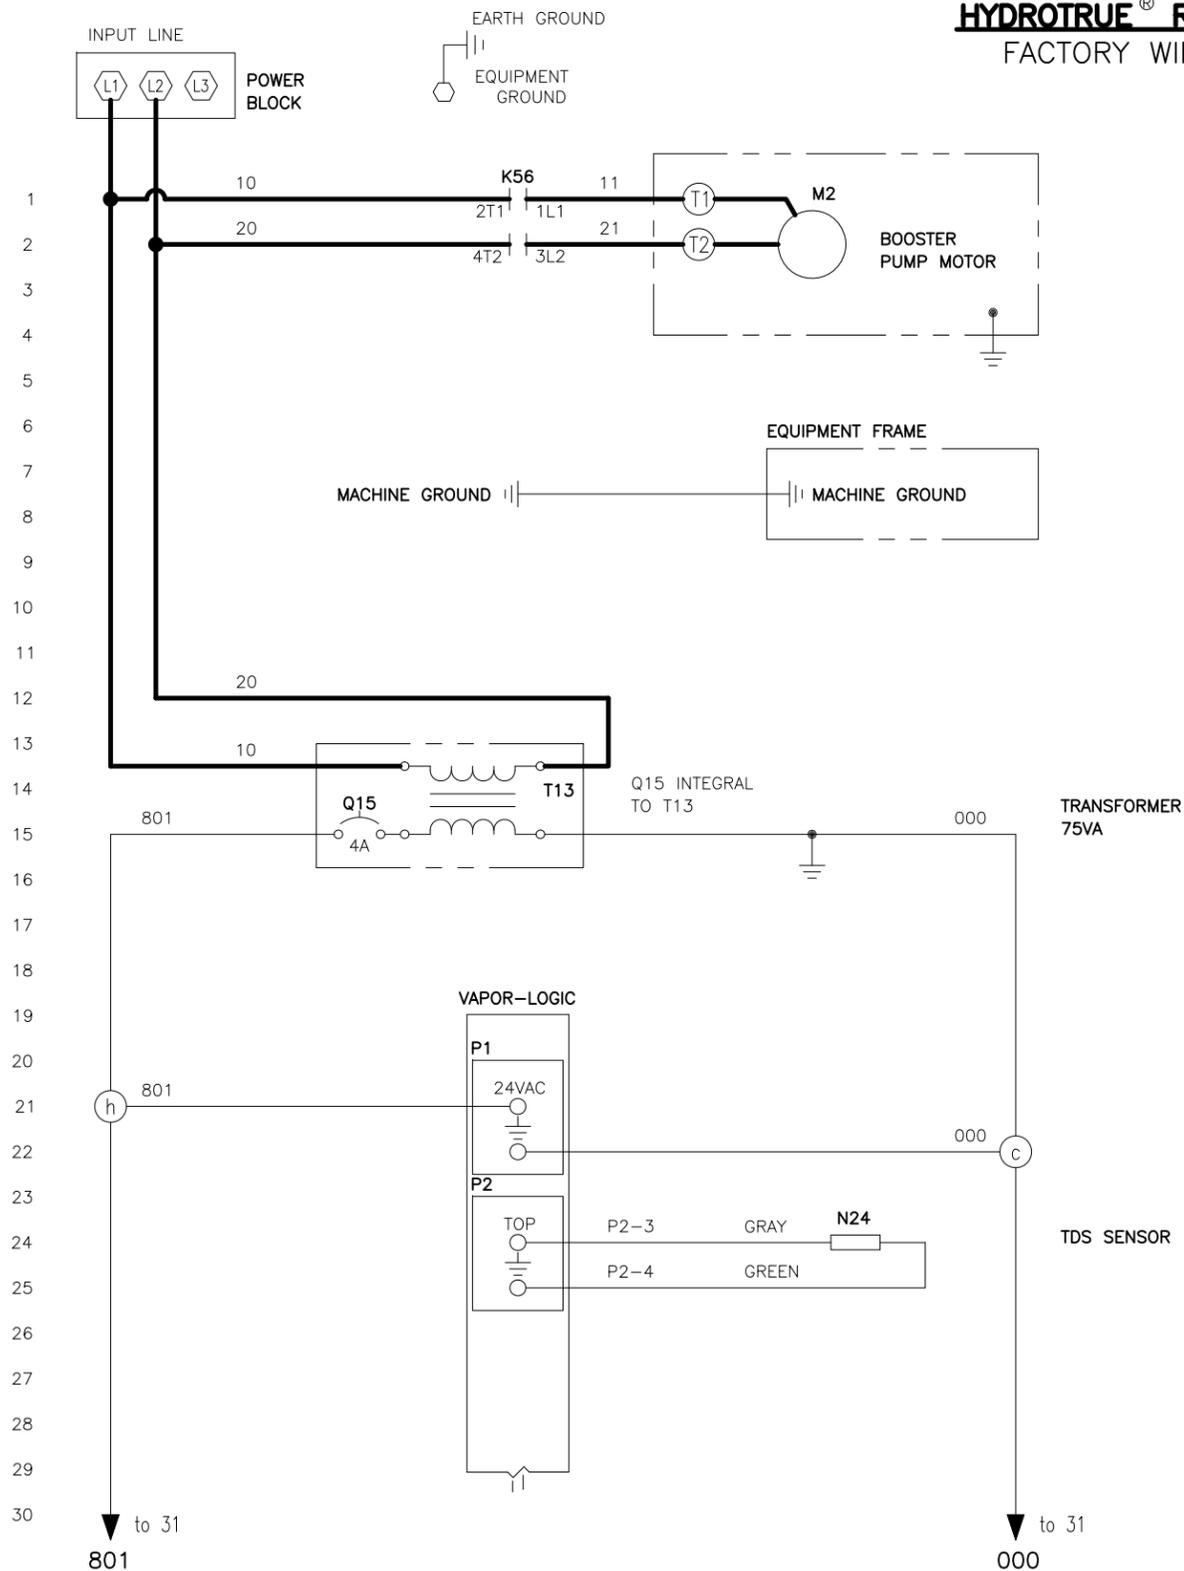

- NOTES:**
1. WIRING & BRANCH CIRCUIT PROTECTION PROVIDED BY INSTALLER AS PER NATIONAL ELECTRICAL CODE.
  2. FOR SUPPLY CONNECTIONS SIZE WIRE USING 75° C WIRE TABLE PER NATIONAL ELECTRICAL CODE,
  3. USE COPPER CONNECTORS RATED FOR 105° C.
  4. REFER TO RO ELECTRICAL DATA SHEET.
5. REMOVE JUMPER IF USING OPTIONAL FLOOR SWITCH.
6. WIRE ACCORDINGLY TO THE FIRST LETTER OF THE CONFIGURATION STRING (P, A)

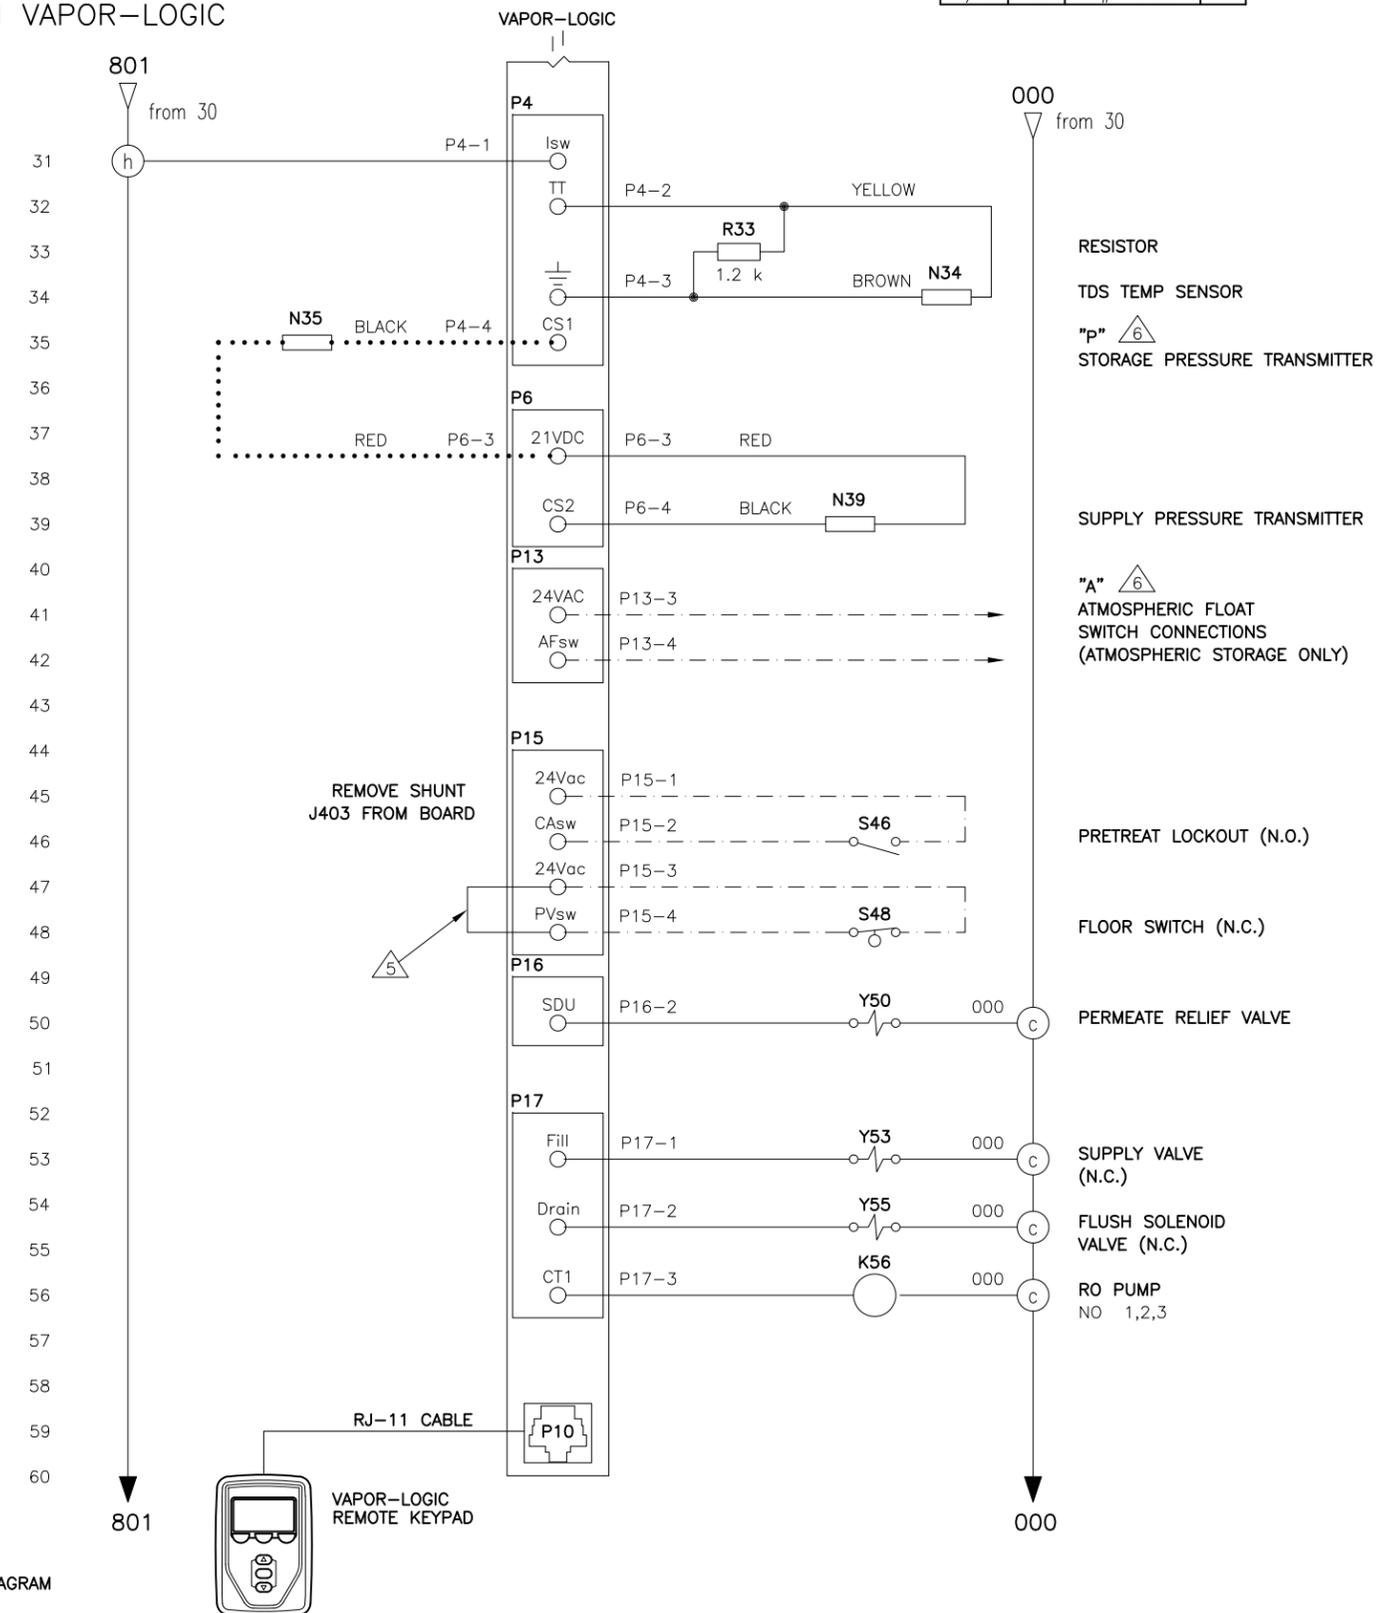

BREAK TO EXTERNAL CONNECTIONS DIAGRAM

**WATER TREATMENT STATION**  
**VAPOR-LOGIC RO-200**  
**WIRING DIAGRAM**

MATERIAL: \_\_\_\_\_  
 SCALE: \_\_\_\_\_ P/N: WT-VL-RO-200-HYDROTRUE  
 DRAWN BY: JK  
 DATE: 12/4/25